



3 Plan
1:10

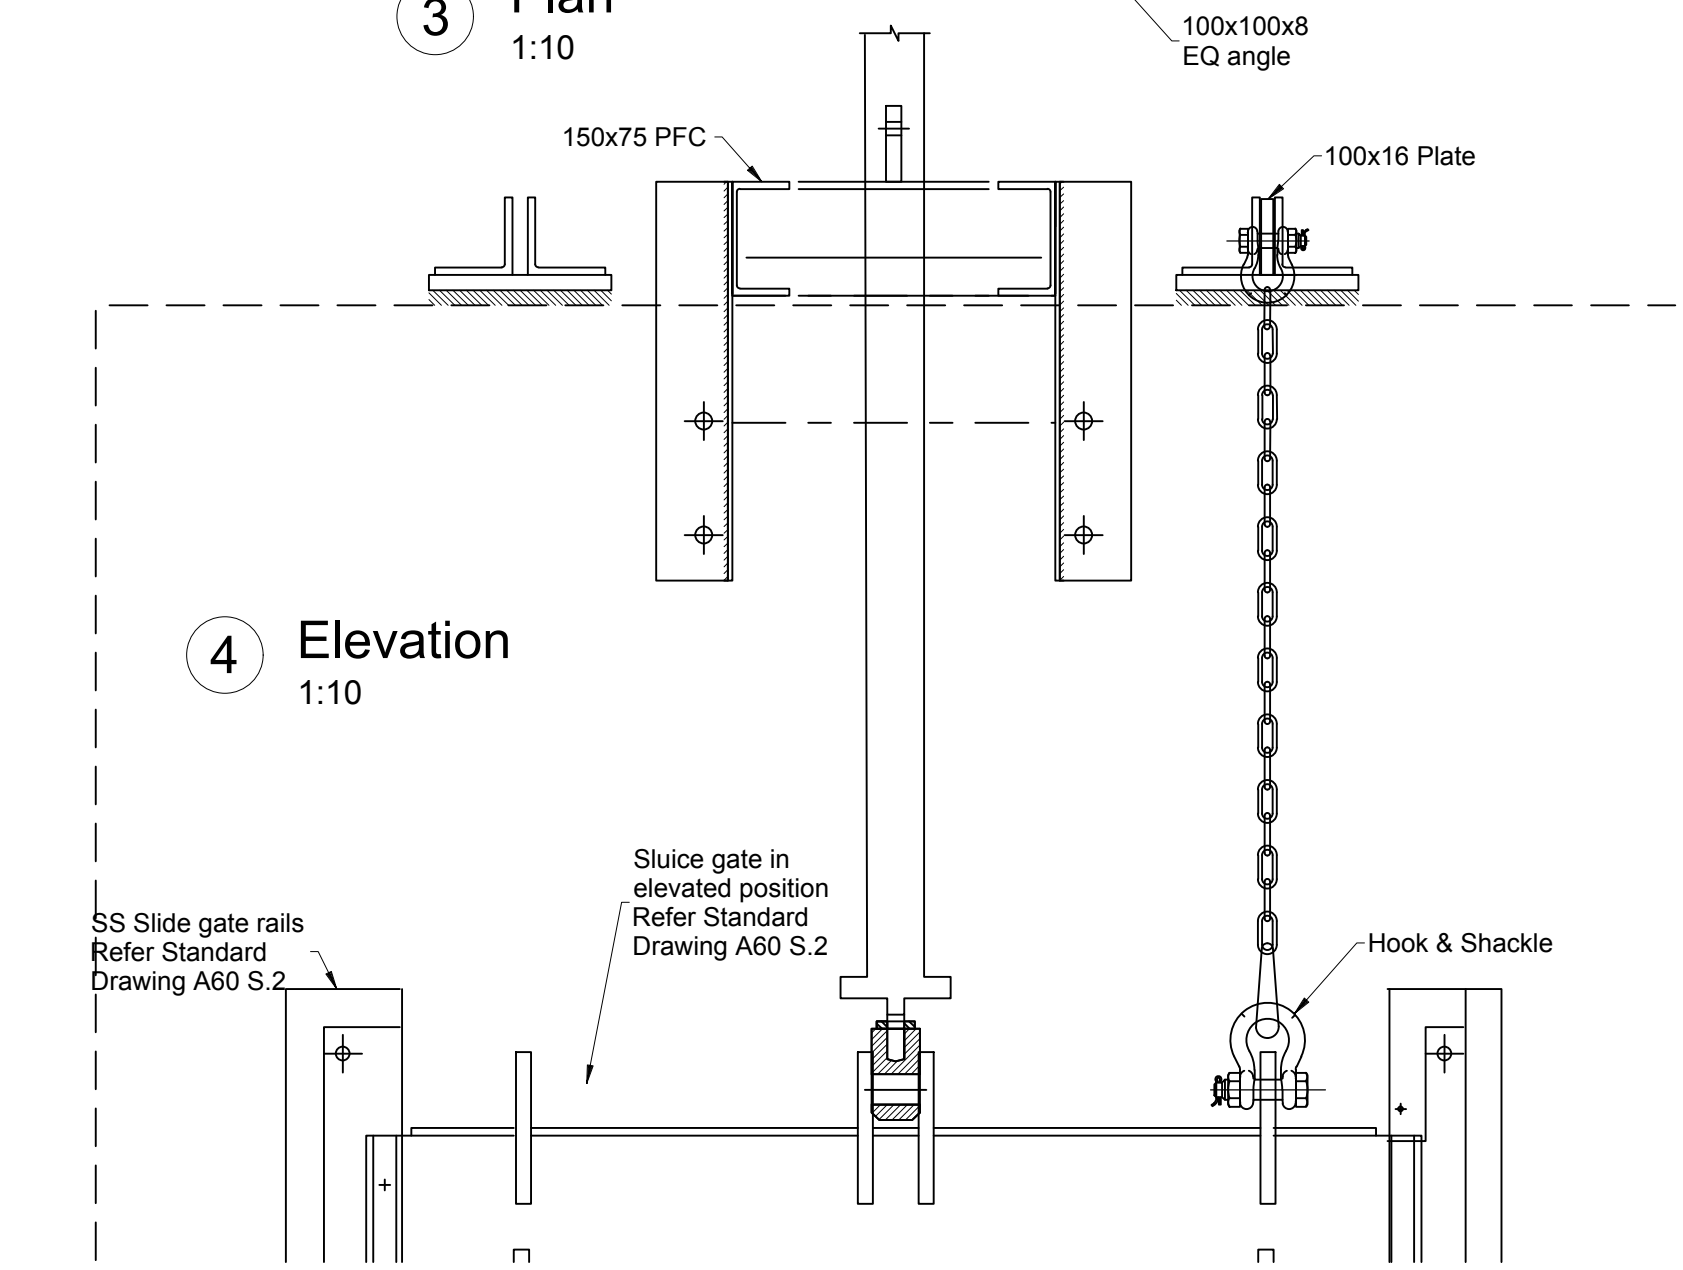

4 Elevation
1:10

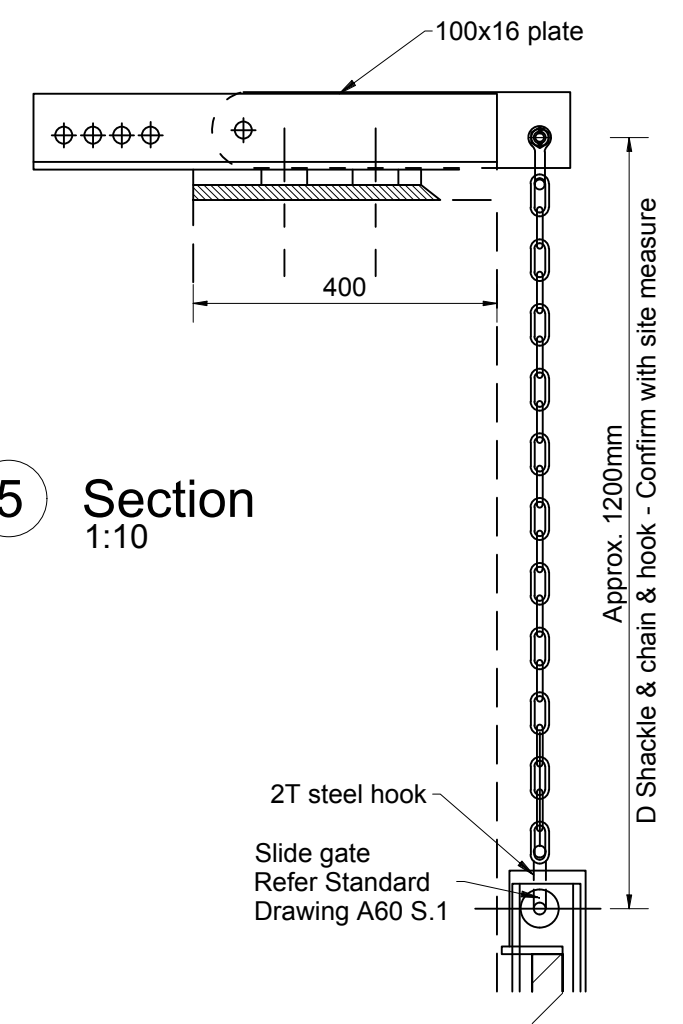

5 Section
1:10

NOTES

1. All dimensions are in millimetres unless otherwise shown.
2. Particular care is to be taken to ensure that all welds are compatible with the materials being joined.
3. Remove all burrs, sharp edges, weld slag and spatter after fabrication is complete.
4. All steel to be hot dip galvanised following fabrication
5. Concrete flood gate wall design thickness = 400mm (TBC).
6. Contractor to confirm dimensions prior to fabrication.
7. Flapgate suitable for outlet diameter >1m and head >4m

0	Construction Issue	A Morphet	29/11/19
Rev	Description	Approved	Date



**Standard Drawings
Sluice Gate
(High Head)**

Date: 29 November 2019	Drawn: A McCaughan	REV
	Checked: M Farrell	0
Drawing Number WRC-1694	S.4	
Scale: As indicated		@ A3