



- NOTES:
1. Read notes on all sheets together with specifications and notify engineer immediately of any discrepancies.
 2. All dimensions are in millimeters unless specified otherwise.
 3. Dimensions are to be verified on site by the Contractor prior to Construction.
 4. All reinforcing to be Grade 500E MA.
 5. Concrete strength to be 30MPa at 28 days.
 6. Concrete exposure class B2.
 7. Minimum concrete cover to be 75mm unless specified otherwise.
 8. Structural Steel Grade 300
 9. All fillet welds to be as shown, else 6mm or thickness of material if smaller. Welds are all-round to avoid moisture trap.
 10. All structural steel elements to be hot-dip galvanised to AS/NZS 4680.
 11. All bolts/threaded rods to be hot-dip galvanised.

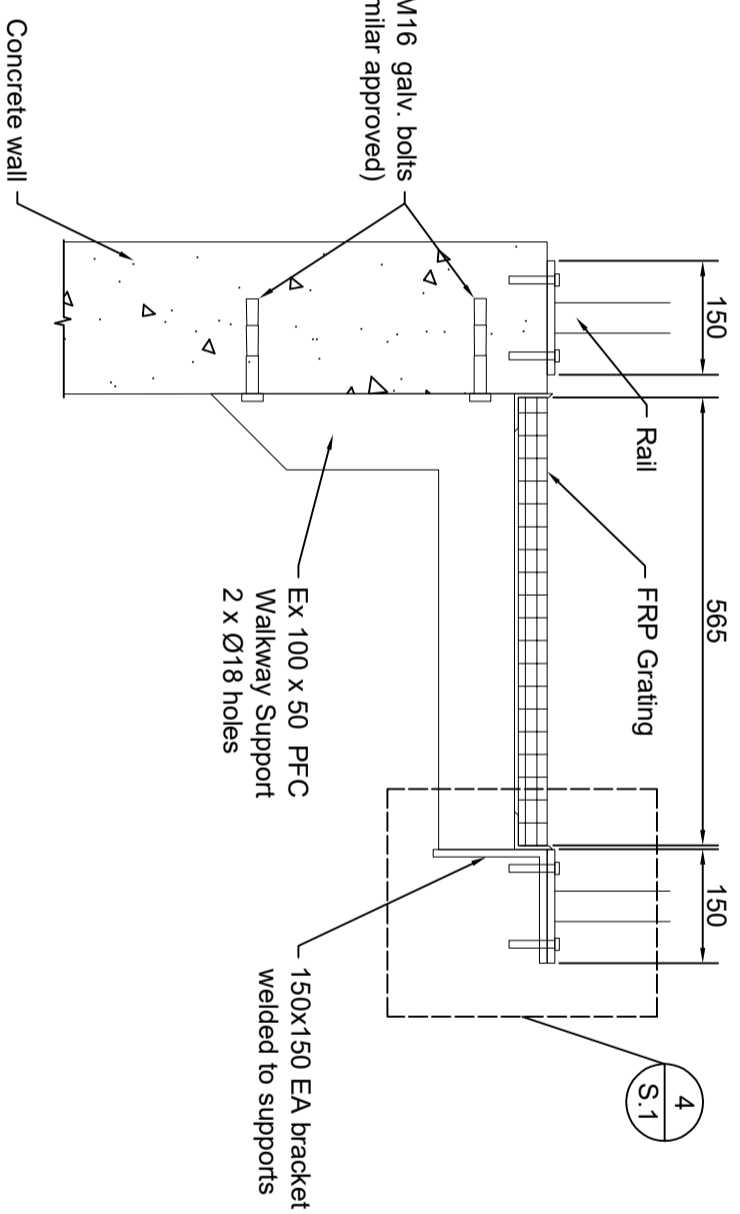


2 Walkway Support Assembly

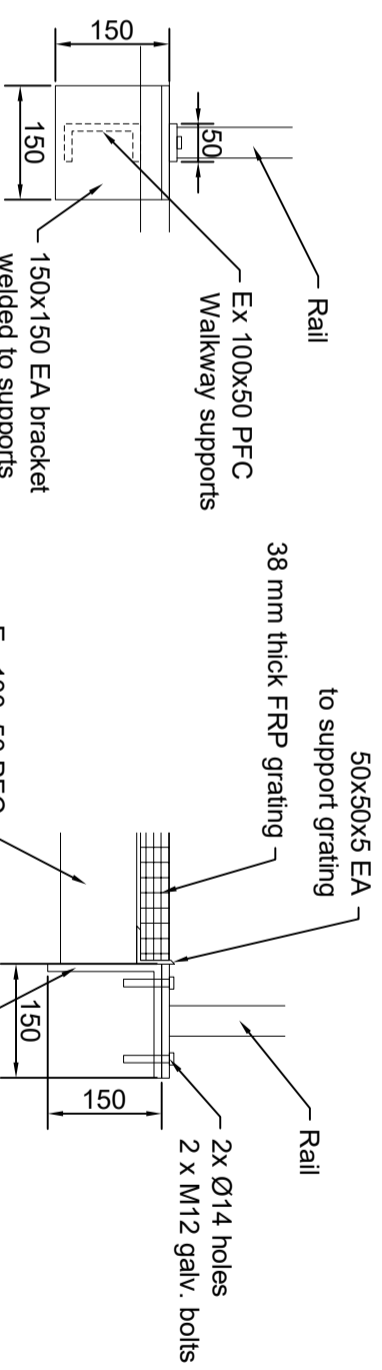


3 Detail

4 Detail

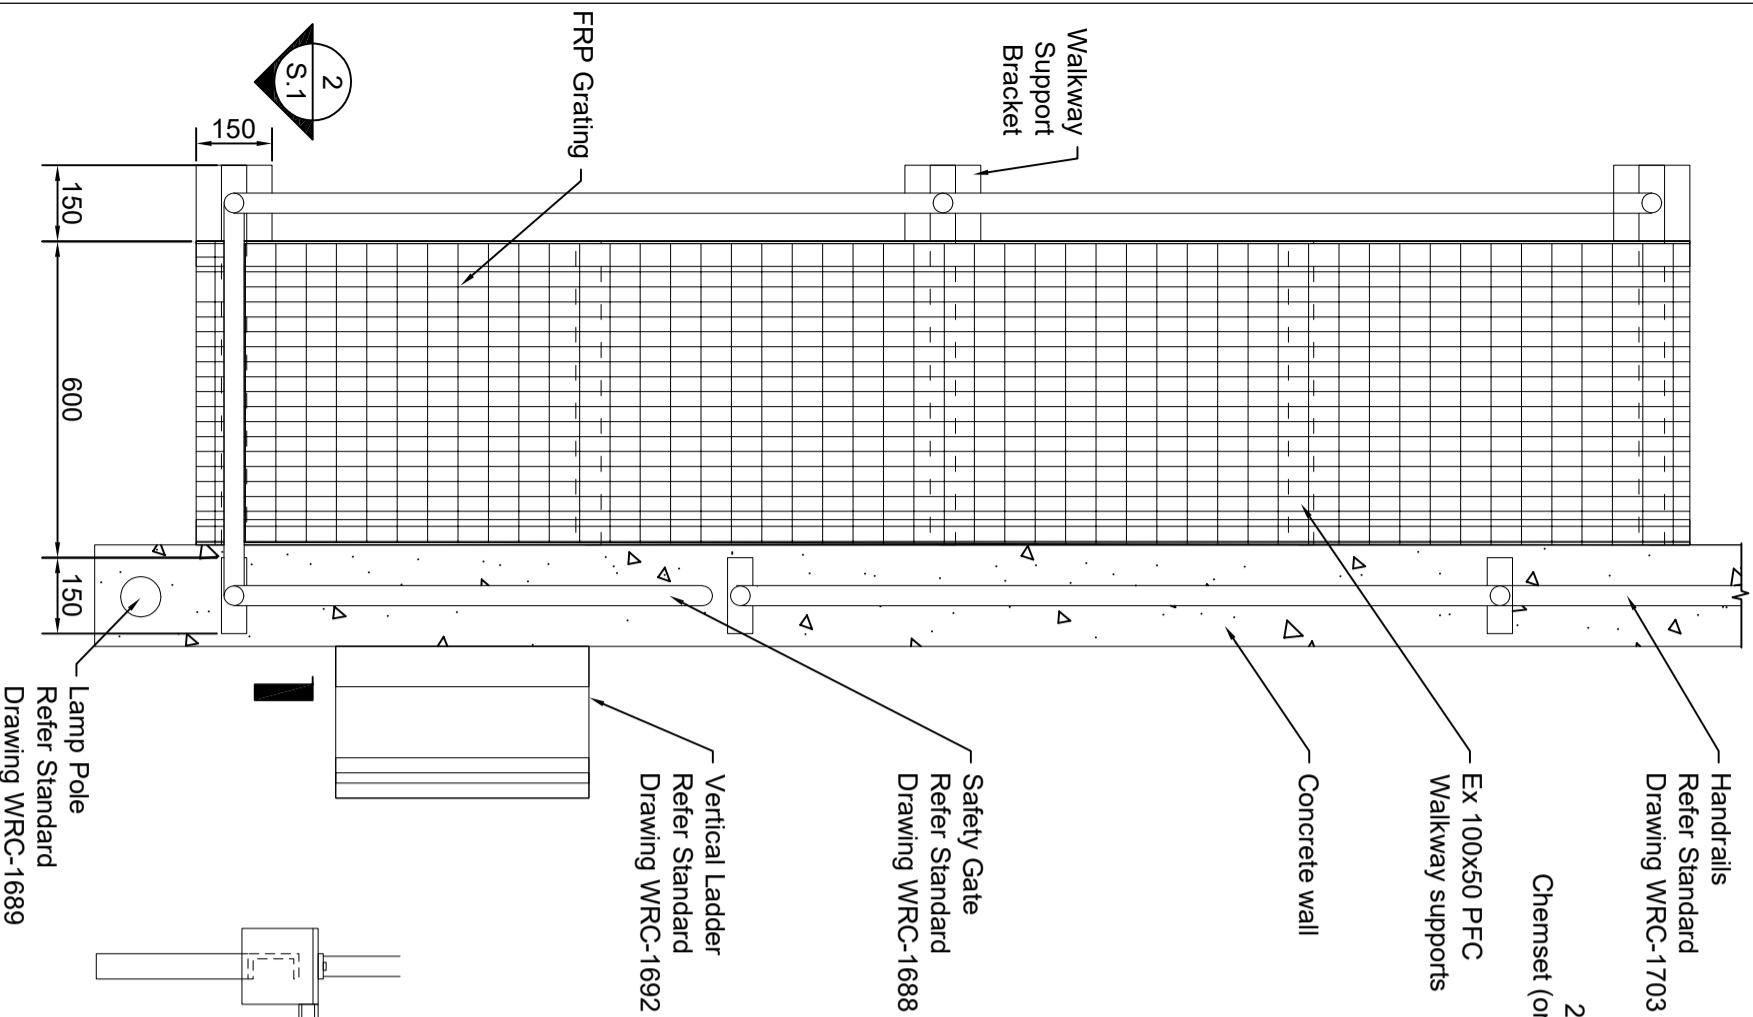

1 Walkway Plan View

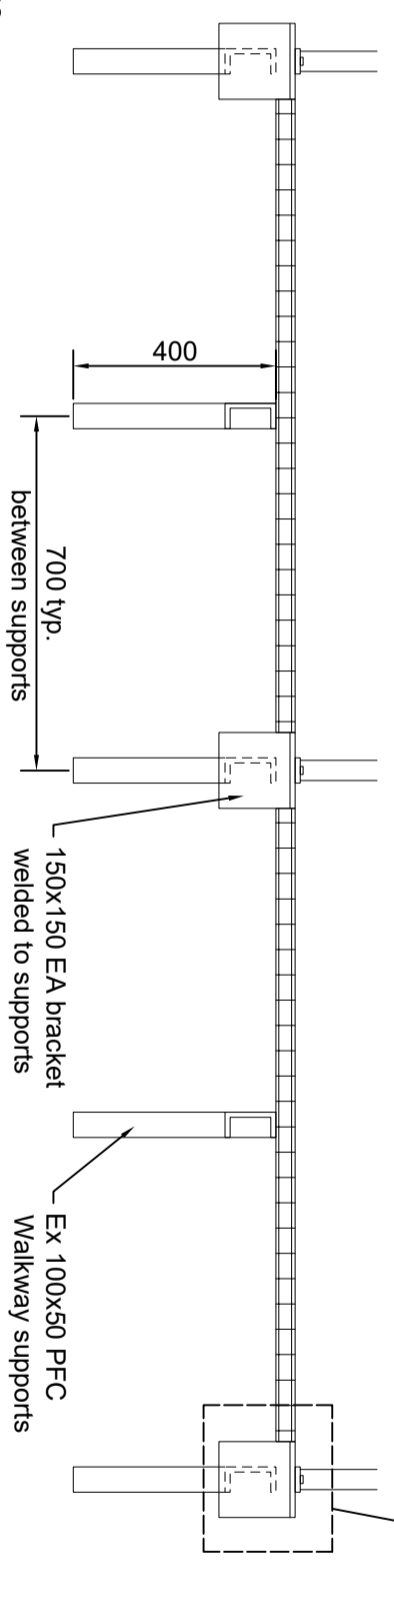

5 Walkway Elevation

Rev	Description	Approved	Date
0	Construction Issue	A Morphet	29/1/19



Standard Drawings

Walkway

Date:	29 November 2019	Drawn:	A McCaughan
Drawing Number:	WRC-1699	Checked:	M Farrell
Scale:	As indicated	REV	0